M3 配电箱(柜)一般配出开关:Acuvim 200
三相电压、电流、有功电能、智能通信接口、电能计量精度0.5级。

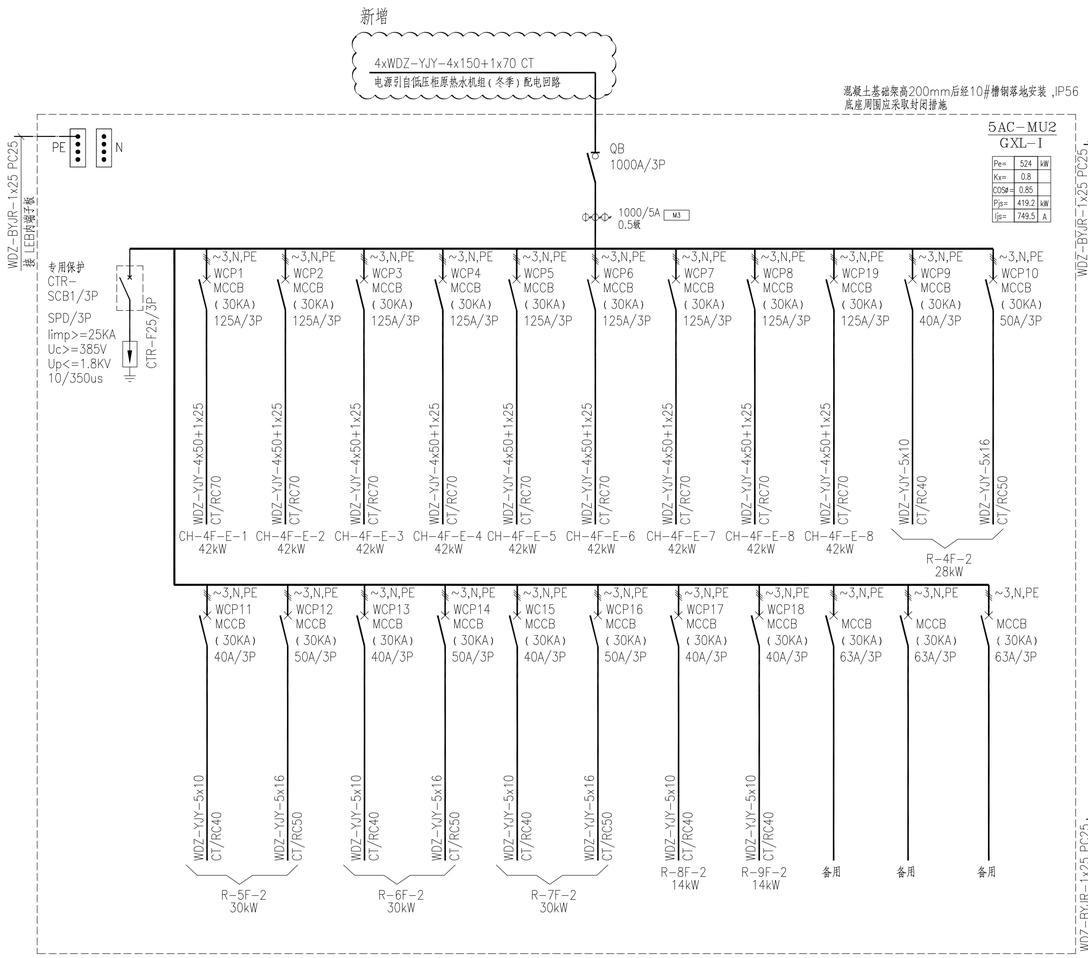

5AC-MU2 系统图

5F空调电源箱

注:此箱为新增

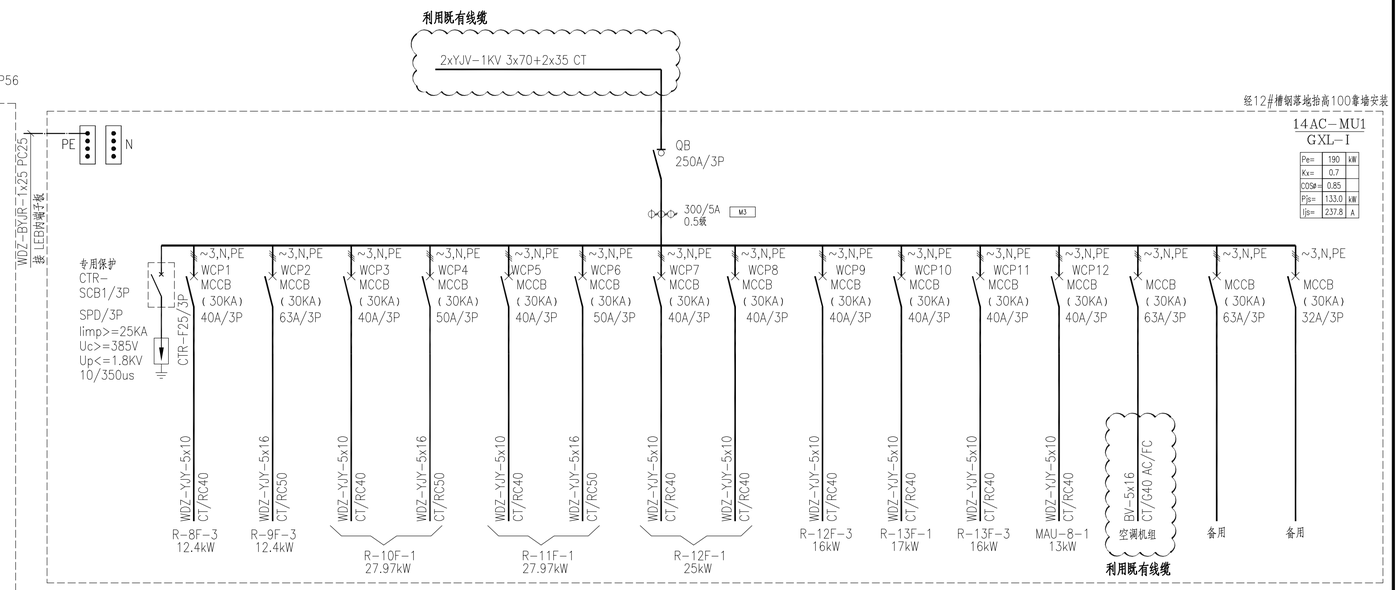

14AC-MU1 系统图

14F空调电源箱

注:此箱为新增,原14DX1箱拆除

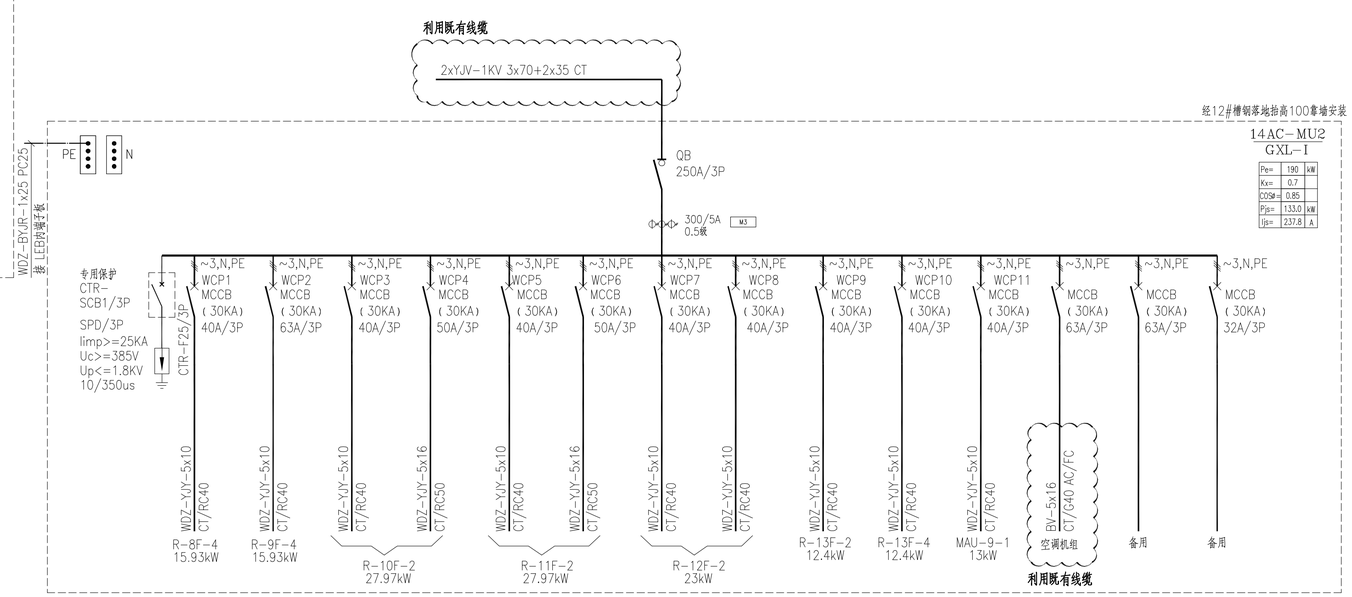

14AC-MU2 系统图

14F空调电源箱

注:此箱为新增,原14DX3箱拆除

江苏省工程勘察设计出图专用章
中衡设计集团股份有限公司
资质证书编号 A132005206 A232005203
江苏省住房和城乡建设厅监制(B)
有效期至二〇二五年六月三十日

平面区位 Key plan	备注 Notes	合作设计 Codesign					
		管理咨询 Management & Consultant					
			0	电气施工图 Detailed design	2025-03-05		
			版本 Rev.	修订说明 Description	日期 Date		

建设单位 Client: 南通市公安局

工程名称 Project title: 南通市公安局部分用房整改

子项名称 Item title:

图纸内容 Dwg title: 配电箱系统图三

审定 Approved			校对 Checked		
复核 Re-examined			专业负责人 Job Mgr.		
审核 Examined			设计 Design	南京威	
项目负责人 Project Mgr.			制图 Drawn	南京威	
工程编号 Job No.	24-4-053	电	图纸编号 Dwg No.		
图幅 Size	A1	子项编号 Item No.	施	E-1-203-0	

本图凡未盖院出图专用章及施工图发图收资人专用章对外无效。版权所有,不得翻制,违者必究。
THIS PRINT AND ITS COPYRIGHT ARE THE PROPERTY OF ARTS GROUP.
IT IS INVALID IN ANY PURPOSE WITHOUT DRAWING SIGNATURE AND SIGNATURE OF CONSTRUCTION DRAWING DELIVERER.
本建施图,结施图凡未盖注册建筑师或注册结构工程师专用章对外无效。
IT IS INVALID IN ANY PURPOSE WITHOUT SIGNATURE OF NATIONAL REGISTERED ARCHITECT OR STRUCTURE ENGINEER.